



Addendum No. 3

Invitation to Tender – ES-16-08

Supply and Install of One Rooftop Chiller Unit 155 George Street

The addendum is being issued prior to the closing of the tender to provide further information, make changes to, or to clarify the Contract Documents and is to be read, interpreted and coordinated with all other parts of the Contract Documents. In the case of a conflict with the balance of the documents, this Addendum shall govern. **Tenders shall acknowledge receipt of this Addendum on the Tender Form and shall attach a signed copy of this addendum to their Tender.** This addendum shall form part of the Contract Documents.

Removal and Change to Prices Tendered & Specifications, page 6:

Change 4th paragraph and Remove picture of Power Cable

“The current chiller runs off 3 phase 575 volt power and is controlled by a 90 amp breaker. The piping size connected to the chiller barrel is 3”.”




Shall be changed to read:

“The current chiller runs off 3 phase 575 volt power and is controlled by a 90 amp Cutler Hammer breaker. Power is transmitted through 2 AWG cable. The piping size connected to the chiller barrel is 3”.”

Remove picture of Power Cable

Add Main Panel Model and Breaker Pictures after 4th paragraph:

Main Panel Model

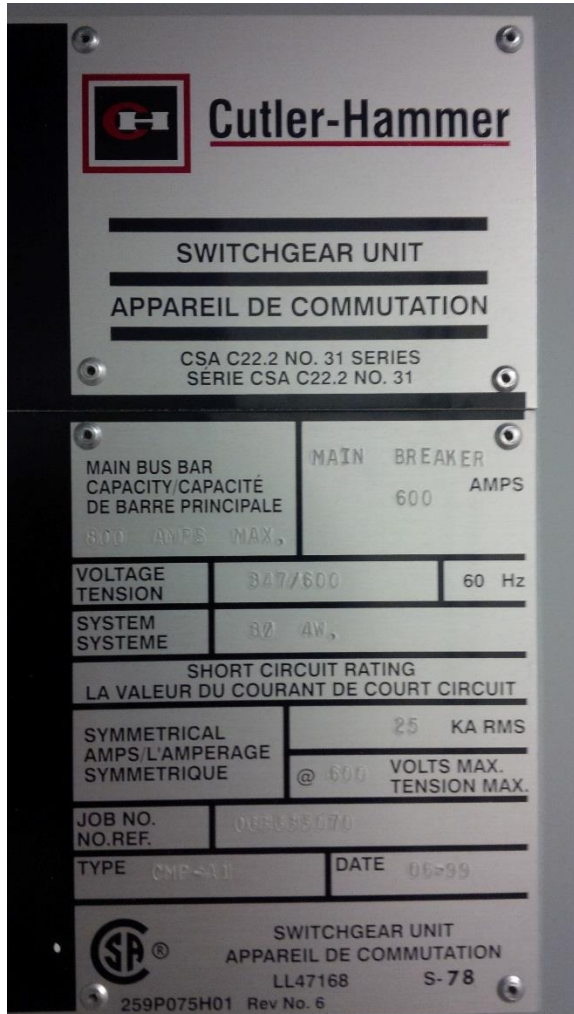

Breaker



Change wording on Specification Sheet, page 12:

Change in table "Minimum rating – 50 tonnes"

Shall be changed to read:

"Minimum rating – 45 tonnes"

Change to contact numbers on Addendum No. 1 and No. 2:

Technical Inquiries:

Bryan Boyes
Utilities Leader
Regional District of Fraser-Fort George
155 George Street
Prince George, BC V2L 1P8
Phone: 250-960-4483 / Fax: 250-526-8676
Email: bboyes@rdffg.bc.ca

General Inquiries:

Petra Wildauer
General Manager of Environmental Services
Regional District of Fraser-Fort George
155 George Street
Prince George, BC V2L 1P8
Phone: 250-960-4483 / Fax: 250-526-8676
Email: pwildauer@rdffg.bc.ca

Shall be changed to read:

Technical Inquiries:

Bryan Boyes
Utilities Leader
Regional District of Fraser-Fort George
155 George Street
Prince George, BC V2L 1P8
Phone: 250-960-4400 / Fax: 250-526-8676
Email: bboyes@rdffg.bc.ca

General Inquiries:

Petra Wildauer
General Manager of Environmental Services
Regional District of Fraser-Fort George
155 George Street
Prince George, BC V2L 1P8
Phone: 250-960-4400 / Fax: 250-526-8676
Email: pwildauer@rdffg.bc.ca

Date: March 23, 2016

Signature

Name:

Inquiries relating to this ITT may be directed to:

Technical Inquiries:

Bryan Boyes
Utilities Leader
Regional District of Fraser-Fort George
155 George Street
Prince George, BC V2L 1P8
Phone: 250-960-4400 / Fax: 250-526-8676
Email: bboyes@rdffg.bc.ca

General Inquiries:

Petra Wildauer
General Manager of Environmental Services
Regional District of Fraser-Fort George
155 George Street
Prince George, BC V2L 1P8
Phone: 250-960-4400 / Fax: 250-526-8676
Email: pwildauer@rdffg.bc.ca